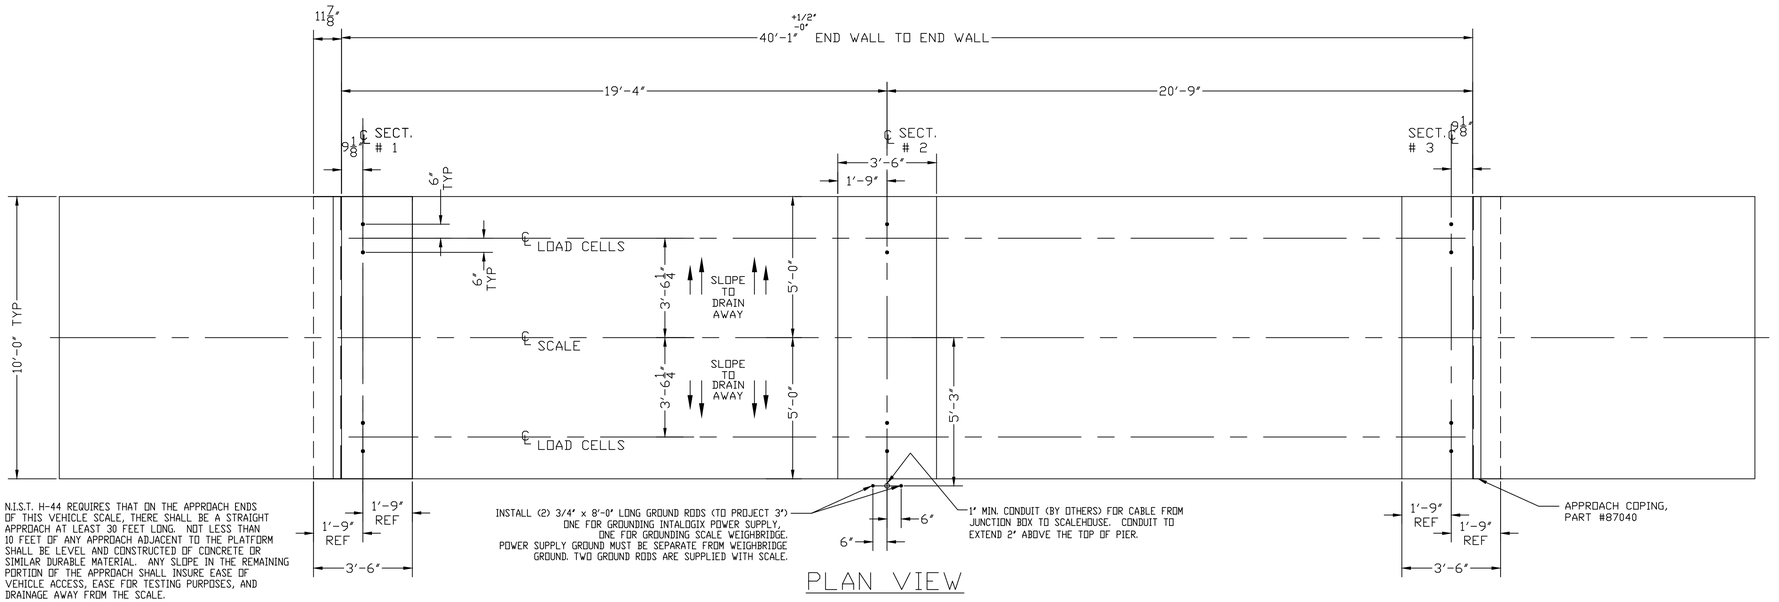


N.I.S.T. H-44 REQUIRES THAT ON THE APPROACH ENDS OF THIS VEHICLE SCALE, THERE SHALL BE A STRAIGHT APPROACH AT LEAST 30 FEET LONG. NOT LESS THAN 10 FEET OF ANY APPROACH ADJACENT TO THE PLATFORM SHALL BE LEVEL AND CONSTRUCTED OF CONCRETE OR SIMILAR DURABLE MATERIAL. ANY SLOPE IN THE REMAINING PORTION OF THE APPROACH SHALL INSURE EASE OF VEHICLE ACCESS, EASE FOR TESTING PURPOSES, AND DRAINAGE AWAY FROM THE SCALE.

PLAN VIEW

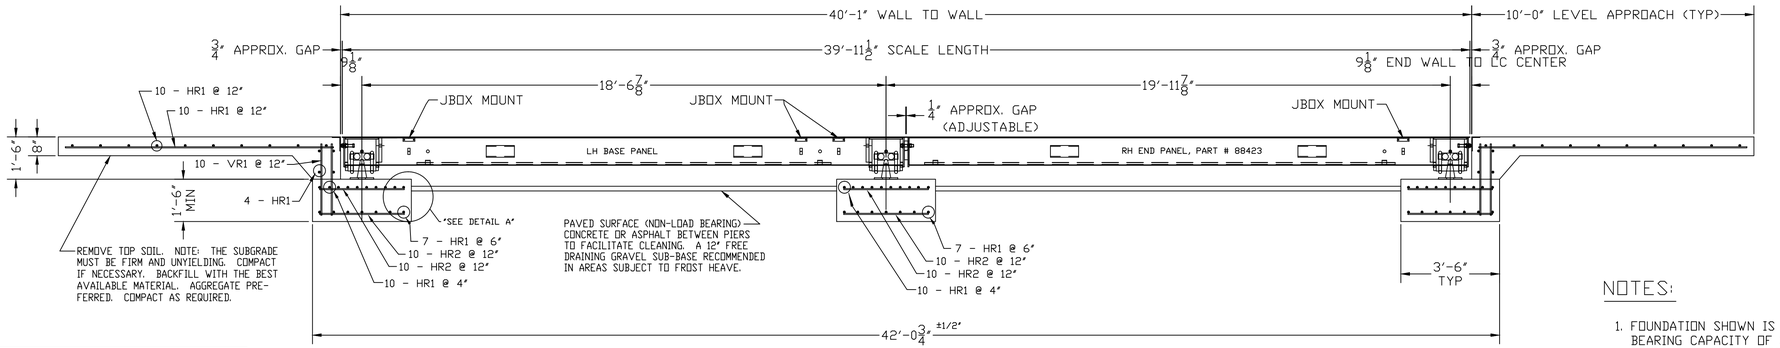


ELEVATION SECTION

| FOUNDATION CONCRETE REQUIREMENTS 4000 P.S.I. | |
|---|---|
| AREA | QUANITIES |
| PIERS AS SHOWN | 6 CU. YD. |
| APPROACHES | 6 CU. YD. |
| FLOOR AT 2" THICK | 2 CU. YD. |
| TOTAL | 14 CU. YD. |

| FOUNDATION REINFORCING BAR SCHEDULE ASTM A615 GRADE 60 | | | | |
|---|---|---|---|---|
| MARK | NO. REQ'D. | SIZE | LENGTH | WT. |
| HR1 | 99 | #4 | 9'-6" | 628 |
| HR2 | 60 | #4 | 3'-0" | 120 |
| VR1 | 40 | #4 | 2'-6" | 67 |
| | | | | |
| | | | | |
| | | | TOTAL WT: | 815 |

REINFORCING STEEL NOTES:

1. REINFORCING STEEL SHALL BE FREE OF ALL MUD, DEBRIS, CEMENT GROUT, LOOSE RUST, GREASE, AND OIL.
2. TACK WELDING OF BARS IS PROHIBITED.

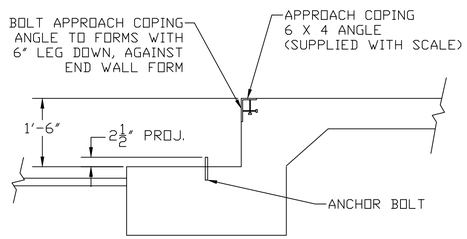


| DRILL TYPE ANCHOR INFORMATION (DRILL TYPE ANCHORS PROVIDED WITH THE SCALE) |
|---|
| FOR THE LC STANDS (12 REQUIRED) 5/8 DIA X 6" STUD TYPE ANCHORS DRILL DIA 5/8", DRILL DEPTH 3 1/2" |

ANCHOR DETAIL

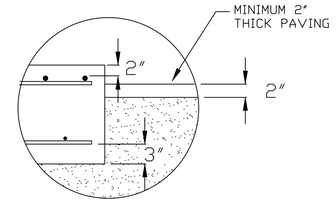


"DETAIL A"

## NOTES:

1. FOUNDATION SHOWN IS DESIGNED FOR SOILS WITH A MINIMUM BEARING CAPACITY OF 3000 PSF AND ADEQUATE DRAINAGE. IF SOIL CONDITIONS DO NOT MEET THESE REQUIREMENTS, ADJUST FOUNDATION OR SOIL CONDITIONS AS REQUIRED.
2. IN AREAS OF THE COUNTRY WHERE THERE IS SEVERE FREEZING, INCREASE THE DEPTH OF THE FOUNDATION SO THAT THE BOTTOM EXTENDS BELOW THE FROST LINE, OR PROVIDE A MINIMUM OF 12" FREE DRAINING GRANULAR MATERIAL TO PREVENT FROST HEAVE.
3. N.I.S.T. H-44 REQUIREMENTS AND LOCAL WEIGHTS AND MEASURES REGULATIONS MAY REQUIRE INSTALLATION PARAMETERS SOMEWHAT DIFFERENT THAN ILLUSTRATED ON THIS PLAN. IN ORDER TO INSURE COMPLIANCE, CONSULT THE LOCAL WEIGHTS & MEASURES OFFICE PRIOR TO CONSTRUCTION.
4. REFER TO SCALE MANUAL FOR INSTALLATION AND OPERATION INSTRUCTIONS.
5. A MINIMUM OF 24" OF CLEARANCE IS REQUIRED ON JUNCTION BOX SIDE OF THE SCALE NEAR THE BOX MOUNTS.

| LET | BY | DATE | REVISION |
|---|---|---|---|
| 1 | JCR | 3/30/11 | 12 ANCHORS REQ'D WAS 16 |

THURMAN SCALE
COLUMBUS, OH

8560 D'BACK 90K CLC 40' X 10' FOUNDATION (3 SECTION, DB LC)

THIS DRAWING IS SUPPLIED AS CHECKED BELOW:
- ☐ REFERENCE (ESTIMATES ONLY, NOT FOR CONSTRUCTION)
- ☐ CERTIFIED FOR CONSTRUCTION, THURMAN #
  CUSTOMER:
  CUSTOMER P.O.# DATE:
- ☐ CUSTOMER APPROVAL, RETURN ONE COPY. (ORDER ON HOLD UNTIL SIGNED COPY IS RETURNED)
- ☐ APPROVED AS DRAWN, APPROVED BY: DATE:
- ☐ APPROVED AS NOTED, APPROVED BY: DATE:

THE MATERIAL AND INFORMATION CONTAINED HEREIN IS CONFIDENTIAL AND IS THE PROPERTY OF THURMAN SCALE COMPANY AND IS NOT TO BE USED, DISCLOSED, COPIED, TRANSFERRED, OR REPRODUCED WITHOUT THE PRIOR WRITTEN PERMISSION OF THURMAN SCALE COMPANY.

UNLESS OTHERWISE SPECIFIED: DIMENSIONS ARE IN INCHES
TOLERANCES: FRACTIONS ±1/8"
ANGLES ±1°
3-PLACE DECIMAL ±0.005
2-PLACE DECIMAL ±0.05
HOLE DIAMETERS ±1/32"

| MATERIAL | FINISH |
|---|---|
| A36 | N/A |

| | |
|---|---|
| DATE | 11/15/07 |
| SCALE: N/A | SHEET 1 OF 1 |
| DRAWN BY: JTB | MODEL: |
| CHECKED BY: | DRAWING NUMBER: 92369-FT |
| APPROVED BY: | REVISION: 1 |